**W2E250-HQ52-12**

# AC axial compact fan

sickled blades (S series)

**ebm-papst Mulfingen GmbH & Co. KG**
Bachmühle 2 · D-74673 Mulfingen
Phone +49 7938 81-0
Fax +49 7938 81-110
info1@de.ebmpapst.com
www.ebmpapst.com

Limited partnership · Headquarters Mulfingen
County court Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen
County court Stuttgart · HRB 590142

## Nominal data

| | |
|---|---|
| **Type** | **W2E250-HQ52-12** |
| **Motor** | **M2E068-DF** |

| | | | | |
|---|---|---|---|---|
| Phase | | 1~ | 1~ | 1~ |
| Nominal voltage | VAC | 230 | 230 | 230 |
| Frequency | Hz | 50 | 60 | 60 |
| Type of data definition | | ml | ml | ml |
| Valid for approval / standard | | CE | CE | UL 2111 |
| Speed (rpm) | $min^{-1}$ | 2500 | 2600 | 2600 |
| Power input | W | 136 | 185 | 195 |
| Current draw | A | 0.61 | 0.82 | 0.83 |
| Motor capacitor | µF | 3 | 3 | 3 |
| Capacitor voltage | VDB | 400 | 400 | 400 |
| Capacitor standard | | S0 (CE) | S0 (CE) | UL |
| Max. back pressure | Pa | 120 | 130 | 130 |
| Min. ambient temperature | °C | -25 | -25 | -25 |
| Max. ambient temperature | °C | 70 | 60 | 60 |
| Starting current | A | 1.15 | 1.07 | |

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations

## Data according to ErP directive

| | | Actual | Request 2015 |
|---|---|---|---|
| 01 Overall efficiency $\eta_{es}$ | % | 29 | 28.1 |
| 02 Measurement category | | A | |
| 03 Efficiency category | | Static | |
| 04 Efficiency grade N | | 40.9 | 40 |
| 05 Variable speed drive | | No | |

| | | |
|---|---|---|
| 09 Power input $P_e$ | kW | 0.13 |
| 09 Air flow $q_v$ | $m^3/h$ | 1200 |
| 09 Pressure increase $p_{fs}$ | Pa | 119 |
| 10 Speed (rpm) n | $min^{-1}$ | 2510 |
| 11 Specific ratio* | | 1.00 |

Data definition with optimum efficiency.
The ErP data is determined using a motor-impeller combination in a standardised measurement configuration.

* Specific ratio = 1 + $p_{fs}$ / 100 000 Pa

LU-156148

# AC axial compact fan

sickled blades (S series)

## Technical features

| | |
|---|---|
| **Mass** | 3.1 kg |
| **Size** | 250 mm |
| **Surface of rotor** | Coated in black |
| **Material of blades** | Press-fitted sheet steel blank, sprayed with PP plastic |
| **Material of wall ring** | Die-cast aluminium |
| **Number of blades** | 7 |
| **Direction of air flow** | "V" |
| **Direction of rotation** | Counter-clockwise, seen on rotor |
| **Type of protection** | IP 44; Depending on installation and position |
| **Insulation class** | "F" |
| **Humidity (F)/environmental protection class (H)** | H0 - dry environment |
| **Max. permissible ambient motor temp. (transp./ storage)** | + 80 °C |
| **Min. permissible ambient motor temp. (transp./storage)** | - 40 °C |
| **Mounting position** | Any |
| **Condensate discharge holes** | None |
| **Operation mode** | S1 |
| **Motor bearing** | Ball bearing |
| **Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)** | < 0.75 mA |
| **Electrical leads** | Via terminal strips, integrated capacitor connected via terminal strips |
| **Motor protection** | Thermal overload protector (TOP) wired internally |
| **Cable exit** | Variable |
| **Protection class** | I (if protective earth is connected by customer) |
| **Motor capacitor according to EN 60252-1 in safety protection class** | S0 |
| **Product conforming to standard** | EN 60335-1; CE |
| **Approval** | CSA C22.2 No.77; UL 2111 |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial compact fan


sickled blades (S series)

## Product drawing

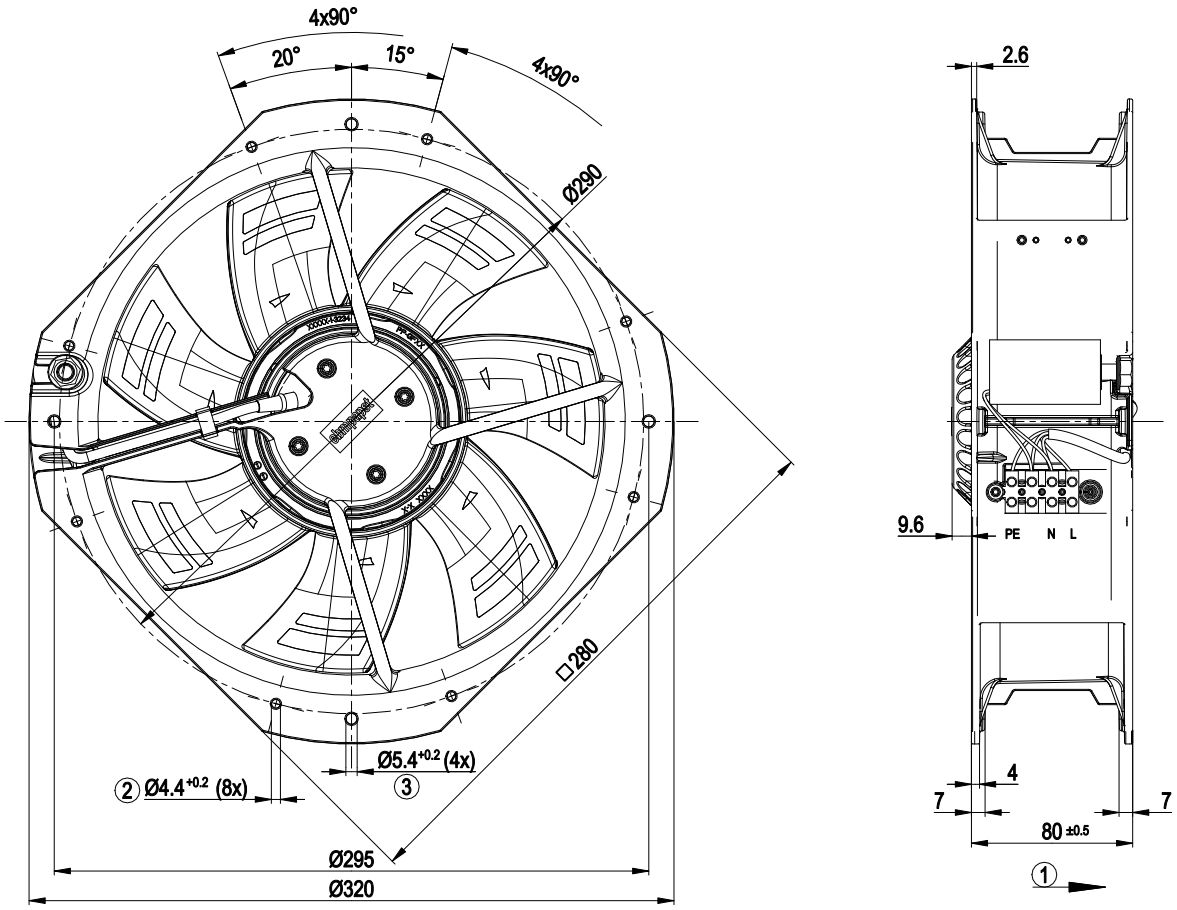


| | |
|---|---|
| 1 | Direction of air flow "V" |
| 2 | For self-tapping M5 screws |
| 3 | For self-tapping M6 screws |

## Connection screen




| | | | | | |
|---|---|---|---|---|---|
| PE | green/yellow | N | blue | L | black |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial compact fan

sickled blades (S series)

## Charts: Air flow 50 Hz

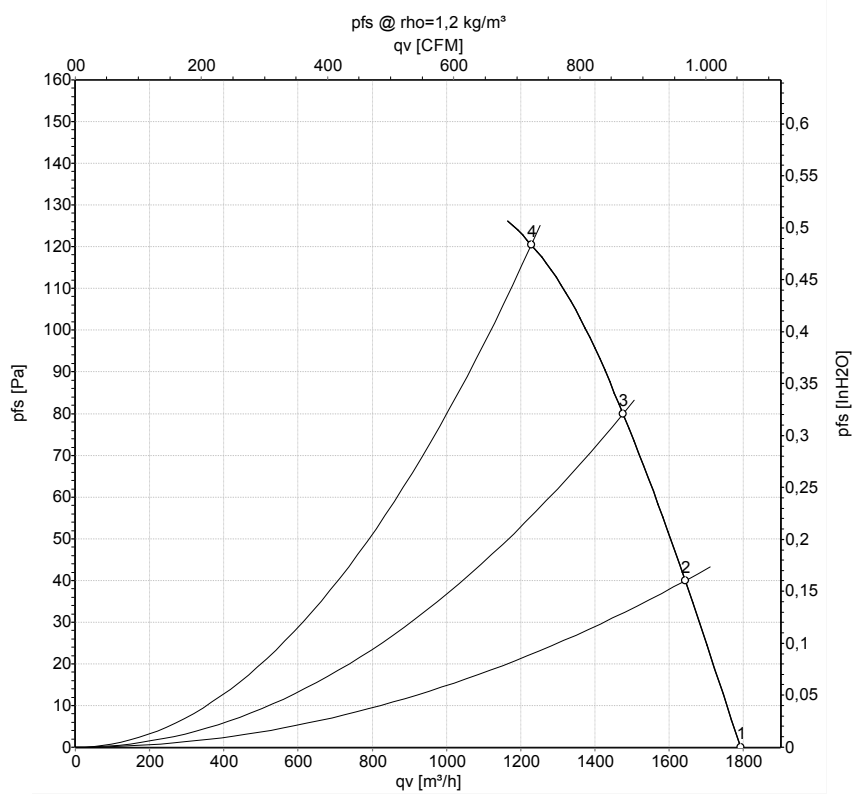


Measurement: LU-156148-1

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

## Measured values

| | U | f | n | $P_e$ | I | $LpA_{in}$ | $LwA_{in}$ | $q_V$ | $p_{fs}$ | $q_V$ | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | V | Hz | $min^{-1}$ | W | A | dB(A) | dB(A) | $m^3/h$ | Pa | cfm | inH2O |
| 1 | 230 | 50 | 2685 | 108 | 0.49 | 62 | 69 | 1790 | 0 | 1055 | 0.00 |
| 2 | 230 | 50 | 2630 | 118 | 0.53 | 63 | 69 | 1645 | 40 | 965 | 0.16 |
| 3 | 230 | 50 | 2570 | 127 | 0.57 | 63 | 70 | 1475 | 80 | 870 | 0.32 |
| 4 | 230 | 50 | 2500 | 136 | 0.61 | 64 | 71 | 1230 | 120 | 725 | 0.48 |

U = Supply voltage · f = Frequency · n = Speed (rpm) · $P_e$ = Power input · I = Current draw · $LpA_{in}$ = Sound pressure level inlet side · $LwA_{in}$ = Sound power level inlet side · $q_V$ = Air flow
$p_{fs}$ = Pressure increase




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial compact fan

sickled blades (S series)

## Charts: Air flow 60 Hz

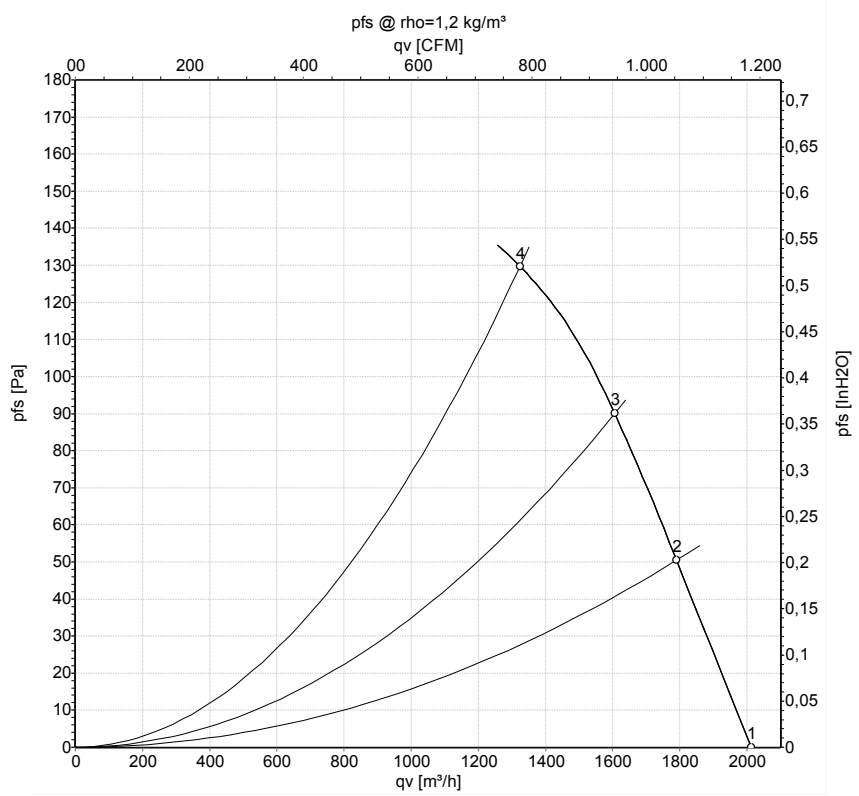


Measurement: LU-156200-1

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

## Measured values

| | U | f | n | $P_e$ | I | $LpA_{in}$ | $LwA_{in}$ | $q_V$ | $p_{fs}$ | $q_V$ | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | V | Hz | $min^{-1}$ | W | A | dB(A) | dB(A) | $m^3/h$ | Pa | cfm | inH2O |
| 1 | 230 | 60 | 2990 | 153 | 0.66 | 65 | 72 | 2015 | 0 | 1185 | 0.00 |
| 2 | 230 | 60 | 2875 | 162 | 0.70 | 65 | 71 | 1790 | 50 | 1055 | 0.20 |
| 3 | 230 | 60 | 2755 | 174 | 0.75 | 64 | 71 | 1605 | 90 | 945 | 0.36 |
| 4 | 230 | 60 | 2600 | 185 | 0.82 | 65 | 72 | 1325 | 130 | 780 | 0.52 |

U = Supply voltage · f = Frequency · n = Speed (rpm) · $P_e$ = Power input · I = Current draw · $LpA_{in}$ = Sound pressure level inlet side · $LwA_{in}$ = Sound power level inlet side · $q_V$ = Air flow
$p_{fs}$ = Pressure increase



ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com