**G2E160-AY47-64**

# AC centrifugal fan

forward-curved, single-intake

with housing (without flange)

**ebm-papst Mulfingen GmbH & Co. KG**
Bachmühle 2 · D-74673 Mulfingen
Phone +49 7938 81-0
Fax +49 7938 81-110
info1@de.ebmpapst.com
www.ebmpapst.com

Limited partnership · Headquarters Mulfingen
Amtsgericht (court of registration) Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen
Amtsgericht (court of registration) Stuttgart · HRB 590142

## Nominal data

| | | | |
|---|---|---|---|
| **Type** | **G2E160-AY47-64** | | |
| **Motor** | **M2E068-EC** | | |
| Phase | | 1~ | 1~ |
| Nominal voltage | VAC | 230 | 230 |
| Frequency | Hz | 50 | 60 |
| Method of obtaining data | | fa | ml |
| Valid for approval/standard | | - | - |
| Speed (rpm) | $min^{-1}$ | 2100 | 2100 |
| Power consumption | W | 240 | 280 |
| Current draw | A | 1.05 | 1.23 |
| Capacitor | µF | 6 | 6 |
| Capacitor voltage | VDB | 400 | 400 |
| Capacitor standard | | S2 (CE) | S2 (CE) |
| Min. back pressure | Pa | 0 | 50 |
| Min. back pressure | inH2O | 0 | 0.2 |
| Min. ambient temperature | °C | -25 | -25 |
| Max. ambient temperature | °C | 50 | 30 |

ml = Max. load · me = Max. efficiency · fa = Free air · cs = Customer specification · ce = Customer equipment
Subject to change

# AC centrifugal fan

forward-curved, single-intake

with housing (without flange)

## Technical description

| | |
|---|---|
| **Weight** | 4.3 kg |
| **Fan size** | 160 mm |
| **Rotor surface** | Unpainted |
| **Terminal box material** | Die-cast aluminum |
| **Impeller material** | Sheet steel, galvanized |
| **Housing material** | Die-cast aluminum |
| **Direction of rotation** | Clockwise, viewed toward rotor |
| **Degree of protection** | IP44; installation- and position-dependent |
| **Insulation class** | "B" |
| **Moisture (F) / Environmental (H) protection class** | H0 - dry environment |
| **Max. permitted ambient temp. for motor (transport/storage)** | + 80 °C |
| **Min. permitted ambient temp. for motor (transport/storage)** | - 40 °C |
| **Installation position** | Any |
| **Condensation drainage holes** | None |
| **Mode** | S1 |
| **Motor bearing** | Ball bearing |
| **Touch current according to IEC 60990 (measuring circuit Fig. 4, TN system)** | < 0.75 mA |
| **Electrical hookup** | Via terminal box, capacitor integrated and connected |
| **Motor protection** | Thermal overload protector (TOP) internally connected |
| **With cable** | Variable |
| **Protection class** | I (if protective earth is connected by customer to the housing's connection point) |
| **Motor capacitor according to EN 60252-1 in safety protection class** | S2 |
| **Conformity with standards** | EN 60335-1 |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC centrifugal fan

forward-curved, single-intake


with housing (without flange)

## Product drawing

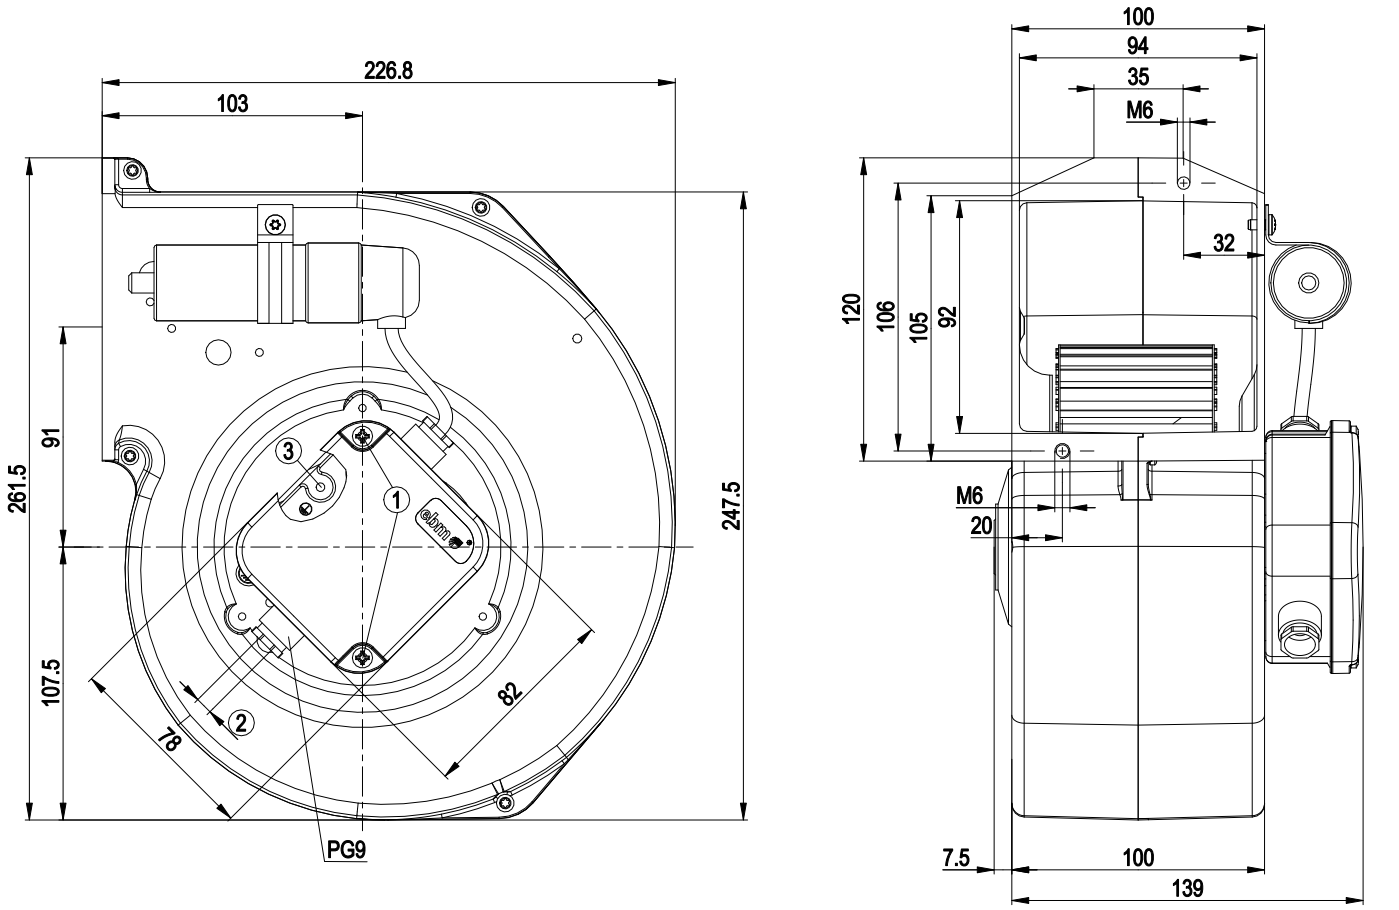


| | |
|---|---|
| 1 | Tightening torque 0.5 ± 0.1 Nm |
| 2 | Cable diameter min. 6 mm, max. 8 mm, tightening torque 2 ± 0.3 Nm |
| 3 | For self-tapping M4 screws, max. clearance for screw 5 mm |

## Connection diagram




| | | | | | |
|---|---|---|---|---|---|
| L | = U1 = blue | Z | brown | N | = U2 = black |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC centrifugal fan

forward-curved, single-intake

with housing (without flange)

## Curves: Air performance 50 Hz

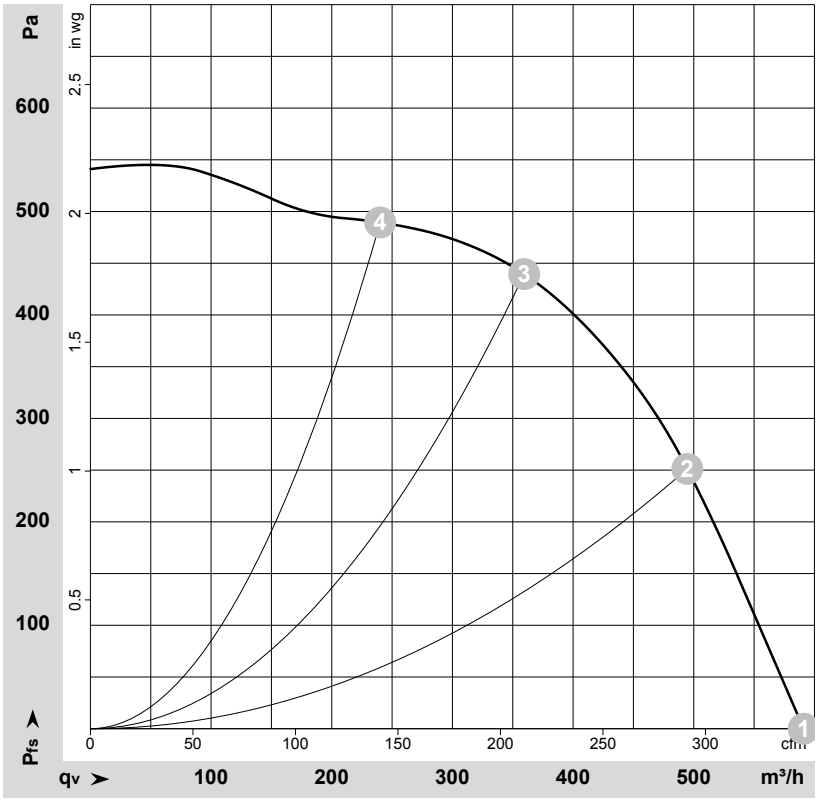


ρ = 1.15 kg/m³ ± 2 %

Measurement: LU-104987-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

## Measured values

| | U | f | n | $P_e$ | I | $q_V$ | $p_{fs}$ | $q_V$ | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|---|
| | V | Hz | $min^{-1}$ | W | A | $m^3/h$ | Pa | cfm | inH2O |
| 1 | 230 | 50 | 2100 | 240 | 1.05 | 590 | 0 | 350 | 0.00 |
| 2 | 230 | 50 | 2385 | 199 | 0.86 | 495 | 250 | 290 | 1.00 |
| 3 | 230 | 50 | 2595 | 161 | 0.70 | 360 | 440 | 210 | 1.77 |
| 4 | 230 | 50 | 2715 | 137 | 0.59 | 240 | 490 | 140 | 1.97 |

U = Power supply · f = Frequency · n = Speed (rpm) · $P_e$ = Power consumption · I = Current draw · $q_V$ = Air flow · $p_{fs}$ = Pressure increase




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC centrifugal fan

forward-curved, single-intake

with housing (without flange)

## Curves: Air performance 60 Hz

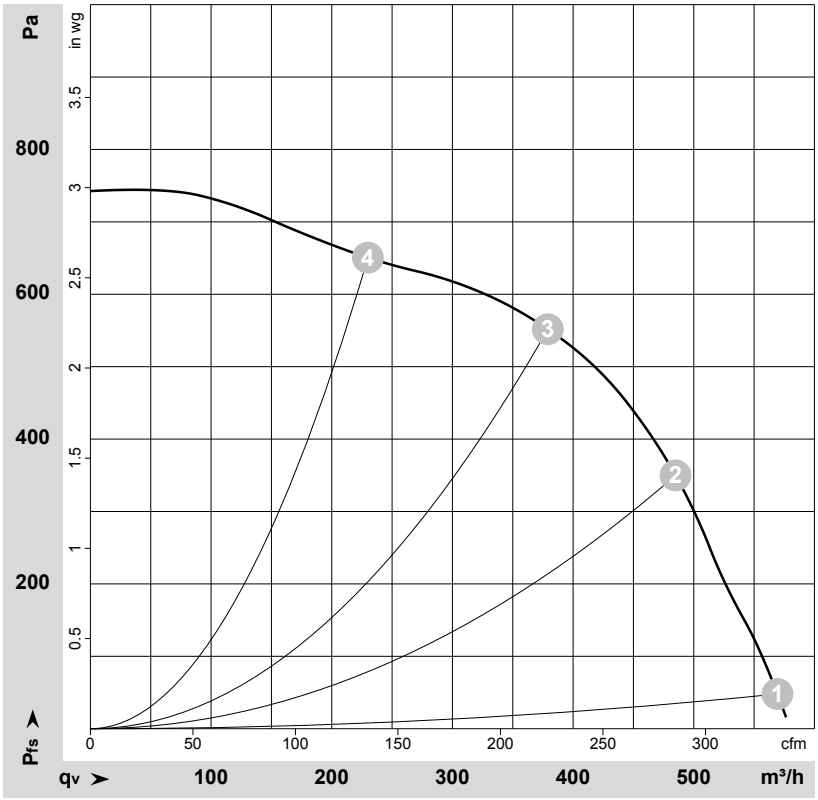


ρ = 1.15 kg/m³ ± 2 %

Measurement: LU-104989-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

## Measured values

| | U | f | n | $P_e$ | I | $q_V$ | $p_{fs}$ | $q_V$ | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|---|
| | V | Hz | $min^{-1}$ | W | A | $m^3/h$ | Pa | cfm | inH2O |
| 1 | 230 | 60 | 2100 | 280 | 1.23 | 570 | 50 | 335 | 0.20 |
| 2 | 230 | 60 | 2580 | 251 | 1.10 | 485 | 350 | 285 | 1.41 |
| 3 | 230 | 60 | 2890 | 216 | 0.96 | 380 | 550 | 225 | 2.21 |
| 4 | 230 | 60 | 3145 | 178 | 0.82 | 230 | 650 | 135 | 2.61 |

U = Power supply · f = Frequency · n = Speed (rpm) · $P_e$ = Power consumption · I = Current draw · $q_V$ = Air flow · $p_{fs}$ = Pressure increase



ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com