**R2E225-BD58-60**

# AC centrifugal fan

backward curved, single inlet

**ebm-papst Mulfingen GmbH & Co. KG**
Bachmühle 2 · D-74673 Mulfingen
Phone +49 7938 81-0
Fax +49 7938 81-110
info1@de.ebmpapst.com
www.ebmpapst.com

Limited partnership · Headquarters Mulfingen
County court Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen
County court Stuttgart · HRB 590142

## Nominal data

| | | |
|---|---|---|
| **Type** | **R2E225-BD58-60** | |
| **Motor** | **M2E068-DF** | |
| Phase | | 1~ |
| Nominal voltage | VAC | 230 |
| Frequency | Hz | 50 |
| Type of data definition | | cu |
| Valid for approval / standard | | - |
| Speed | $min^{-1}$ | 2300 |
| Power input | W | 150 |
| Current draw | A | 0.66 |
| Motor capacitor | µF | 4 |
| Capacitor voltage | VDB | 400 |
| Capacitor standard | | P2 (CE) |
| Min. back pressure | Pa | 0 |
| Min. ambient temperature | °C | -25 |
| Max. ambient temperature | °C | 60 |
| Starting current | A | 0.79 |

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations

# AC centrifugal fan

backward curved, single inlet

## Technical features

| | |
|---|---|
| **Mass** | 2.3 kg |
| **Size** | 225 mm |
| **Surface of rotor** | Coated in black |
| **Material of impeller** | Plastic PA66, fibreglass-reinforced, round sheet-metal plate coated in black |
| **Number of blades** | 7 |
| **Direction of rotation** | Clockwise, seen on rotor |
| **Type of protection** | IP 44 |
| **Insulation class** | "F" |
| **Humidity class** | F1-2 |
| **Max. permissible ambient motor temp. (transp./ storage)** | + 80 °C |
| **Min. permissible ambient motor temp. (transp./storage)** | - 40 °C |
| **Mounting position** | Shaft horizontal or rotor on bottom; rotor on top on request |
| **Condensate discharge holes** | Rotor-side |
| **Operation mode** | S1 |
| **Motor bearing** | Ball bearing |
| **Speed steps** | 4 |
| **Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)** | < 0.75 mA |
| **Motor protection** | Thermal overload protector (TOP) wired internally |
| **Cable exit** | Variable |
| **Protection class** | I (if protective earth is connected by customer) |
| **Product conforming to standard** | EN 60335-1 |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC centrifugal fan

backward curved, single inlet

## Product drawing

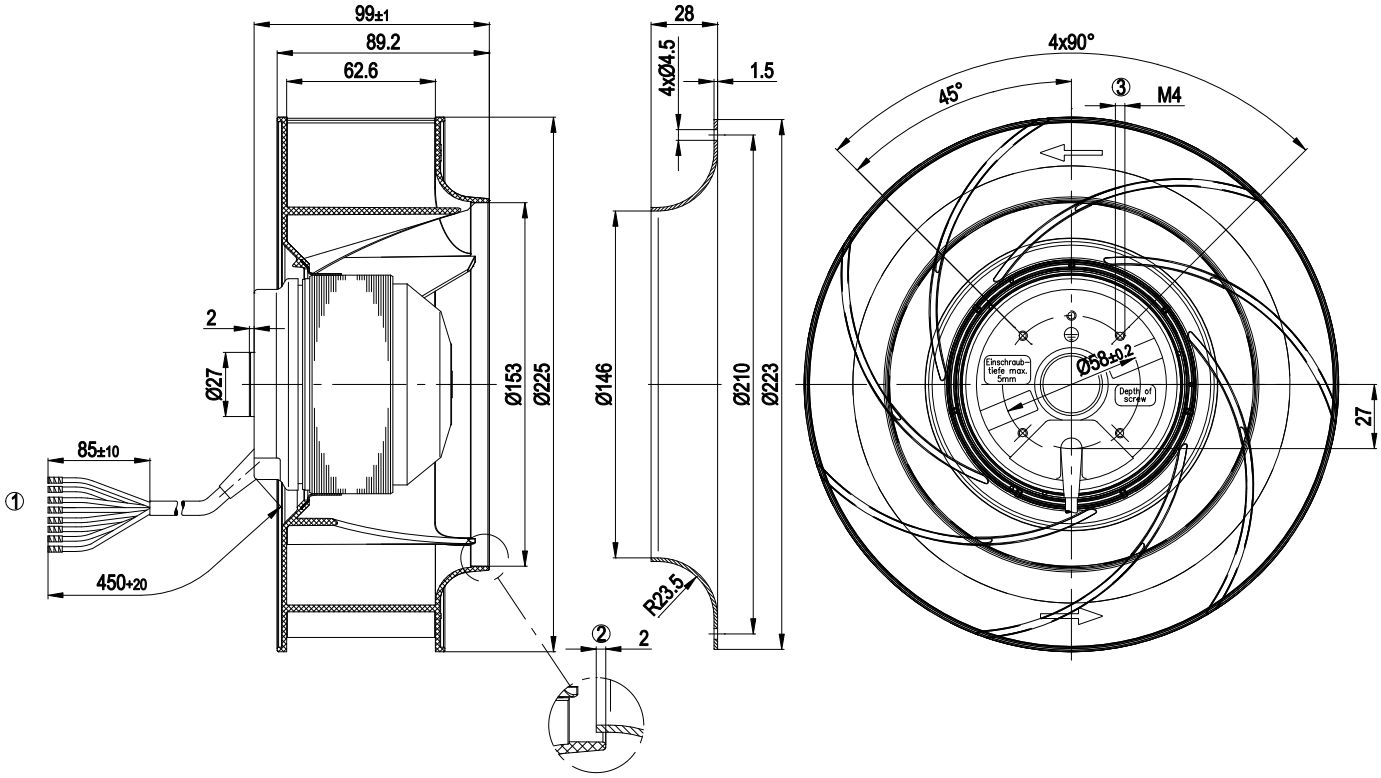


| | |
|---|---|
| 1 | Connection line Dipotherm, 8x brass lead tips crimped |
| 2 | Accessory part: Inlet nozzle 96358-2-4013, not included in the standard scope of delivery |
| 3 | Depth of screw max. 5 mm |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC centrifugal fan

backward curved, single inlet

## Connection screen

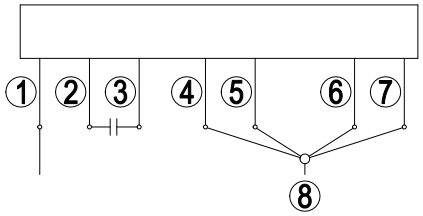


Note: fast speed (step IV); slow speed (step I); the switch must interrupt the circuit during the changeover.

| | |
|---|---|
| 1 | = N = blue |
| 2 | brown |
| 3 | yellow |
| 4 | Step I black 1 / white |
| 5 | Step II black 2 / red |
| 6 | Step III black 3 / grey |
| 7 | Step IV black 4 / black |
| 8 | L1 |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC centrifugal fan

backward curved, single inlet

## Charts: Air flow 50 Hz

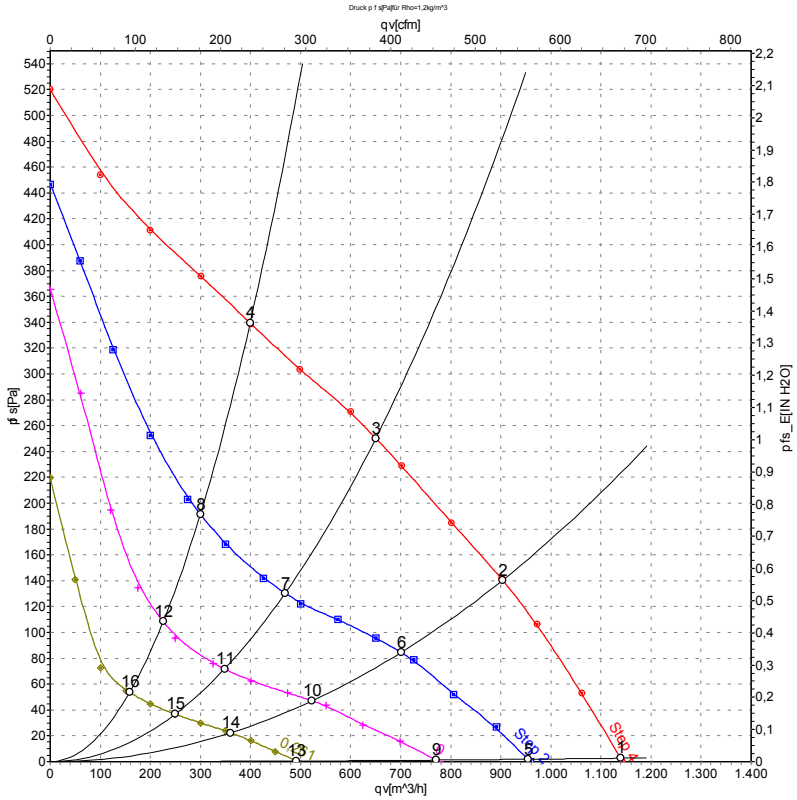


Measurement: LU-122444
Measurement: LU-122451
Measurement: LU-122458
Measurement: LU-122460

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

## Measured values

| | Stage | U | f | n | $P_e$ | I | qv | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|
| | | V | Hz | $min^{-1}$ | W | A | $m^3/h$ | Pa |
| 1 | 4 | 230 | 50 | 2600 | 115 | 0.53 | 1140 | 0 |
| 2 | 4 | 230 | 50 | 2495 | 128 | 0.57 | 905 | 140 |
| 3 | 4 | 230 | 50 | 2425 | 135 | 0.60 | 650 | 250 |
| 4 | 4 | 230 | 50 | 2455 | 131 | 0.58 | 400 | 340 |
| 5 | 3 | 230 | 50 | 2175 | 89 | 0.44 | 955 | 0 |
| 6 | 3 | 230 | 50 | 1935 | 98 | 0.47 | 700 | 85 |
| 7 | 3 | 230 | 50 | 1765 | 103 | 0.48 | 470 | 130 |
| 8 | 3 | 230 | 50 | 1845 | 100 | 0.47 | 300 | 191 |
| 9 | 2 | 230 | 50 | 1760 | 86 | 0.41 | 770 | 0 |
| 10 | 2 | 230 | 50 | 1450 | 91 | 0.43 | 525 | 47 |
| 11 | 2 | 230 | 50 | 1310 | 93 | 0.43 | 350 | 72 |
| 12 | 2 | 230 | 50 | 1385 | 91 | 0.43 | 225 | 108 |
| 13 | 1 | 230 | 50 | 1155 | 79 | 0.37 | 490 | 0 |
| 14 | 1 | 230 | 50 | 1010 | 81 | 0.38 | 360 | 22 |
| 15 | 1 | 230 | 50 | 930 | 81 | 0.38 | 250 | 37 |
| 16 | 1 | 230 | 50 | 975 | 80 | 0.38 | 160 | 53 |

U = Supply voltage · f = Frequency · n = Speed · $P_e$ = Power input · I = Current draw · qv = Air flow · $p_{fs}$ = Pressure increase



ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com