**S4D300-AS34-17**

# AC axial fan

sickle-shaped blades (S series)

with guard grille for short nozzle

**ebm-papst Mulfingen GmbH & Co. KG**
Bachmühle 2 · D-74673 Mulfingen
Phone +49 7938 81-0
Fax +49 7938 81-110
info1@de.ebmpapst.com
www.ebmpapst.com

Limited partnership · Headquarters Mulfingen
Amtsgericht (court of registration) Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen
Amtsgericht (court of registration) Stuttgart · HRB 590142

## Nominal data

| | |
|---|---|
| **Type** | **S4D300-AS34-17** |
| **Motor** | **M4D068-CF** |

| | | | | | |
|---|---|---|---|---|---|
| Phase | | 3~ | 3~ | 3~ | 3~ |
| Nominal voltage | VAC | 230 | 230 | 400 | 400 |
| Wiring | | Δ | Δ | Y | Y |
| Frequency | Hz | 50 | 60 | 50 | 60 |
| Method of obtaining data | | ml | ml | ml | ml |
| Valid for approval/standard | | CE | CE | CE | CE |
| Speed (rpm) | $min^{-1}$ | 1300 | 1400 | 1300 | 1400 |
| Power consumption | W | 68 | 90 | 68 | 90 |
| Current draw | A | 0.25 | 0.26 | 0.14 | 0.15 |
| Max. back pressure | Pa | 60 | 70 | 60 | 70 |
| Max. back pressure | inH2O | 0.24 | 0.28 | 0.24 | 0.28 |
| Min. ambient temperature | °C | -25 | -25 | -25 | -25 |
| Max. ambient temperature | °C | 60 | 55 | 60 | 55 |

ml = Max. load · me = Max. efficiency · fa = Free air · cs = Customer specification · ce = Customer equipment
Subject to change

# AC axial fan

sickle-shaped blades (S series)

with guard grille for short nozzle

## Technical description

| | |
|---|---|
| **Weight** | 2.4 kg |
| **Fan size** | 300 mm |
| **Rotor surface** | Painted black |
| **Terminal box material** | PP plastic |
| **Blade material** | PP plastic |
| **Guard grille material** | Steel, coated with black plastic (RAL 9005) |
| **Number of blades** | 5 |
| **Airflow direction** | "V" |
| **Direction of rotation** | Counterclockwise, viewed toward rotor |
| **Degree of protection** | IP44; installation- and position-dependent as per EN 60034-5 |
| **Insulation class** | "B" |
| **Moisture (F) / Environmental (H) protection class** | F2-2 |
| **Max. permitted ambient temp. for motor (transport/storage)** | + 80 °C |
| **Min. permitted ambient temp. for motor (transport/storage)** | - 40 °C |
| **Installation position** | Shaft horizontal or rotor on bottom; rotor on top on request |
| **Condensation drainage holes** | On rotor side |
| **Mode** | S1 |
| **Motor bearing** | Ball bearing |
| **Touch current according to IEC 60990 (measuring circuit Fig. 4, TN system)** | < 0.75 mA |
| **Electrical hookup** | Via terminal box |
| **With cable** | Axial |
| **Protection class** | I (with customer connection of protective earth) |
| **Conformity with standards** | EN 60335-1 |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial fan

sickle-shaped blades (S series)

with guard grille for short nozzle

## Product drawing

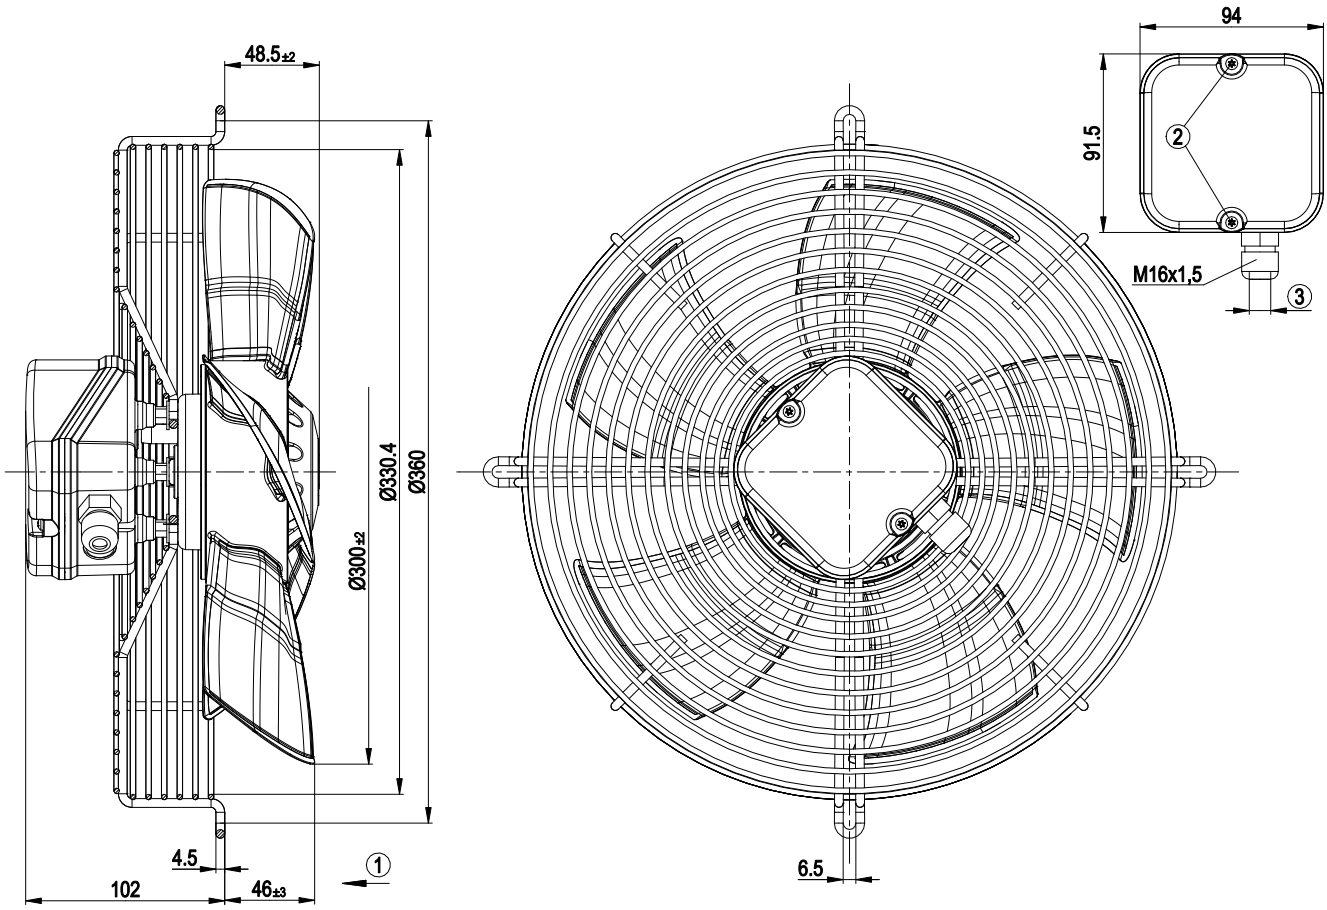


| | |
|---|---|
| 1 | Direction of air flow "V" |
| 2 | Tightening torque 0.5±0.1 Nm |
| 3 | Cable diameter: min. 6 mm, max. 12 mm, tightening torque 1.3±0.2 Nm |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial fan

sickle-shaped blades (S series)

with guard grille for short nozzle

## Connection diagram

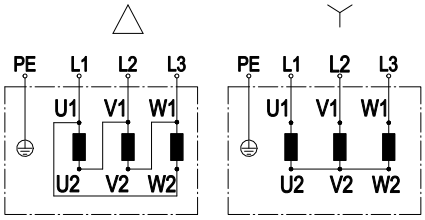


Change of rotation direction by reversing two phases

| | | | | | |
|---|---|---|---|---|---|
| | Three-phase motor | Δ | Delta connection | Y | Star connection |
| L1 | = U1 = black | L2 | = V1 = blue | L3 | = W1 = brown |
| U2 | green | V2 | white | W2 | yellow |
| PE | green/yellow | | | | |




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial fan

sickle-shaped blades (S series)

with guard grille for short nozzle

## Curves: Air performance 50 Hz

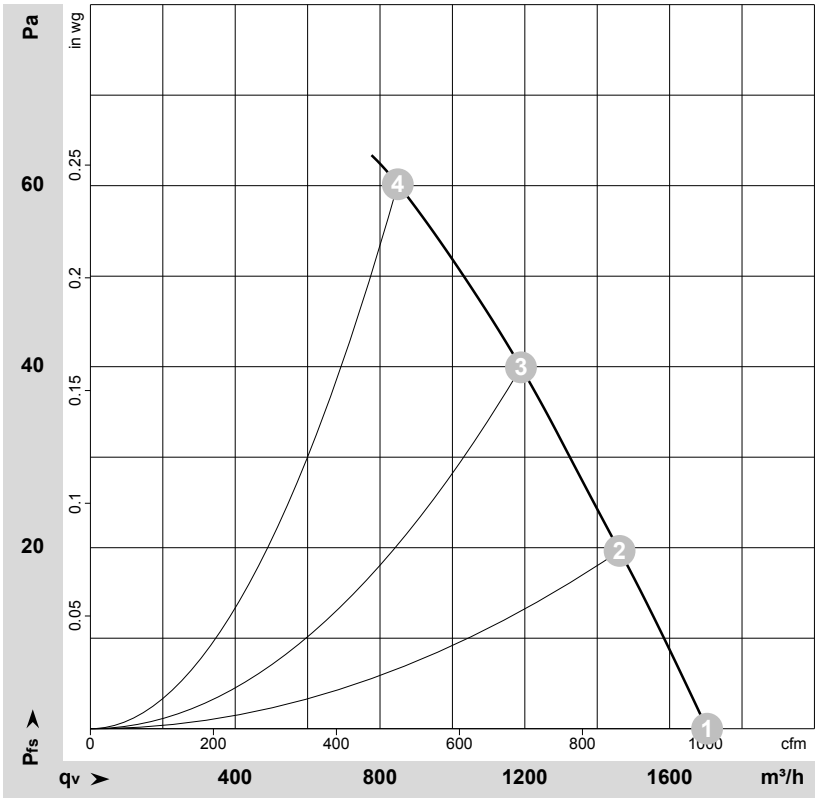


ρ = 1.15 kg/m³ ± 2 %

Measurement: LU-114649-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

## Measured values

| | Wired | U | f | n | $P_e$ | I | $LpA_{in}$ | $LwA_{in}$ | qv | $p_{fs}$ | qv | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | V | Hz | $min^{-1}$ | W | A | dB(A) | dB(A) | $m^3/h$ | Pa | CFM | inH2O |
| 1 | Y | 400 | 50 | 1370 | 53 | 0.13 | 52 | 59 | 1705 | 0 | 1000 | 0.00 |
| 2 | Y | 400 | 50 | 1350 | 57 | 0.13 | 51 | 58 | 1460 | 20 | 860 | 0.08 |
| 3 | Y | 400 | 50 | 1335 | 61 | 0.13 | 51 | 58 | 1190 | 40 | 700 | 0.16 |
| 4 | Y | 400 | 50 | 1300 | 68 | 0.14 | 57 | 65 | 850 | 60 | 500 | 0.24 |

Wired = Wiring · U = Power supply · f = Frequency · n = Speed (rpm) · $P_e$ = Power consumption · I = Current draw · $LpA_{in}$ = Sound pressure level intake side · $LwA_{in}$ = Sound power level intake side
qv = Air flow · $p_{fs}$ = Pressure increase




ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com

# AC axial fan

sickle-shaped blades (S series)

with guard grille for short nozzle

## Curves: Air performance 60 Hz

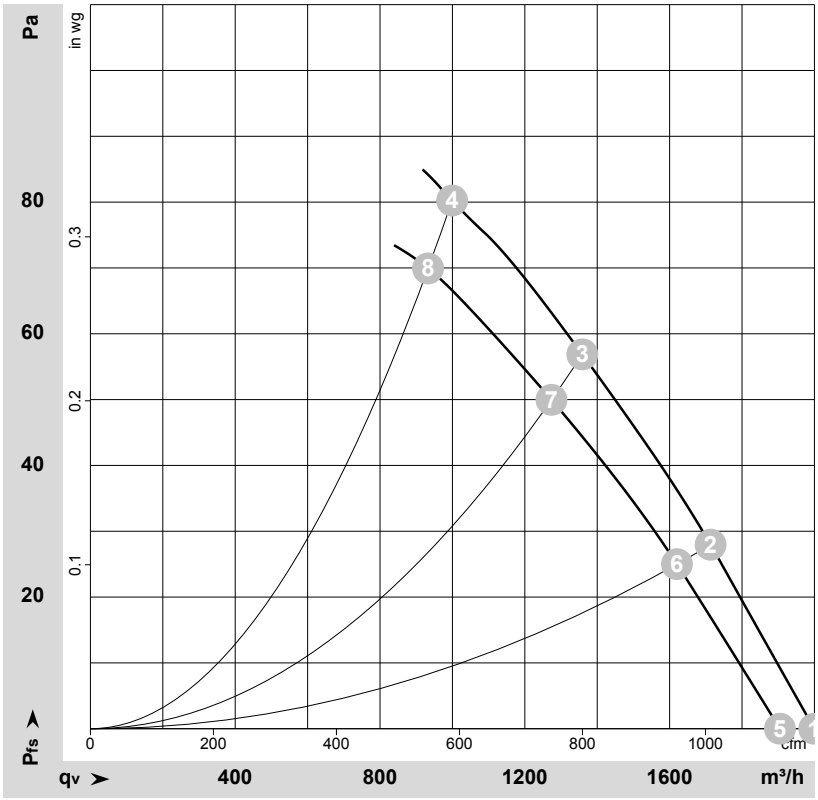


ρ = 1.15 kg/m³ ± 2 %

Measurement: LU-114654-1
Measurement: LU-114653-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

## Measured values

| | Wired | U | f | n | $P_e$ | I | $LpA_{in}$ | $LwA_{in}$ | qv | $p_{fs}$ | qv | $p_{fs}$ |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | V | Hz | $min^{-1}$ | W | A | dB(A) | dB(A) | $m^3/h$ | Pa | CFM | inH2O |
| 1 | Y | 480 | 60 | 1605 | 79 | 0.14 | | | 2000 | 0 | 1175 | 0.00 |
| 2 | Y | 480 | 60 | 1580 | 86 | 0.14 | | | 1715 | 28 | 1010 | 0.11 |
| 3 | Y | 480 | 60 | 1560 | 92 | 0.15 | | | 1360 | 57 | 800 | 0.23 |
| 4 | Y | 480 | 60 | 1510 | 105 | 0.16 | | | 1000 | 80 | 590 | 0.32 |
| 5 | Y | 400 | 60 | 1530 | 69 | 0.13 | 55 | 62 | 1905 | 0 | 1120 | 0.00 |
| 6 | Y | 400 | 60 | 1495 | 75 | 0.13 | 54 | 61 | 1620 | 25 | 955 | 0.10 |
| 7 | Y | 400 | 60 | 1460 | 80 | 0.14 | 54 | 61 | 1275 | 50 | 750 | 0.20 |
| 8 | Y | 400 | 60 | 1400 | 90 | 0.15 | 60 | 68 | 935 | 70 | 550 | 0.28 |

Wired = Wiring · U = Power supply · f = Frequency · n = Speed (rpm) · $P_e$ = Power consumption · I = Current draw · $LpA_{in}$ = Sound pressure level intake side · $LwA_{in}$ = Sound power level intake side
qv = Air flow · $p_{fs}$ = Pressure increase



ebm-papst Mulfingen GmbH & Co. KG · Bachmühle 2 · D-74673 Mulfingen · Phone +49 (0) 7938 81-0 · Fax +49 (0) 7938 81-110 · info1@de.ebmpapst.com · www.ebmpapst.com